



SPRINKLER SPECIFICATIONS



1. At the time of such closing or opening of the system, the Contractor shall notify the owner and the fire department who will make the necessary arrangements to keep the shutdown time to a minimum.
2. The Contractor shall keep the shutdown time to a minimum.
3. The Contractor shall keep the shutdown time to a minimum.
4. The Contractor shall keep the shutdown time to a minimum.
5. The Contractor shall keep the shutdown time to a minimum.
6. The Contractor shall keep the shutdown time to a minimum.
7. The Contractor shall keep the shutdown time to a minimum.
8. The Contractor shall keep the shutdown time to a minimum.
9. The Contractor shall keep the shutdown time to a minimum.
10. The Contractor shall keep the shutdown time to a minimum.
11. The Contractor shall keep the shutdown time to a minimum.
12. The Contractor shall keep the shutdown time to a minimum.
13. The Contractor shall keep the shutdown time to a minimum.
14. The Contractor shall keep the shutdown time to a minimum.
15. The Contractor shall keep the shutdown time to a minimum.
16. The Contractor shall keep the shutdown time to a minimum.
17. The Contractor shall keep the shutdown time to a minimum.
18. The Contractor shall keep the shutdown time to a minimum.
19. The Contractor shall keep the shutdown time to a minimum.
20. The Contractor shall keep the shutdown time to a minimum.
21. The Contractor shall keep the shutdown time to a minimum.
22. The Contractor shall keep the shutdown time to a minimum.
23. The Contractor shall keep the shutdown time to a minimum.
24. The Contractor shall keep the shutdown time to a minimum.
25. The Contractor shall keep the shutdown time to a minimum.
26. The Contractor shall keep the shutdown time to a minimum.
27. The Contractor shall keep the shutdown time to a minimum.
28. The Contractor shall keep the shutdown time to a minimum.
29. The Contractor shall keep the shutdown time to a minimum.
30. The Contractor shall keep the shutdown time to a minimum.
31. The Contractor shall keep the shutdown time to a minimum.
32. The Contractor shall keep the shutdown time to a minimum.
33. The Contractor shall keep the shutdown time to a minimum.
34. The Contractor shall keep the shutdown time to a minimum.
35. The Contractor shall keep the shutdown time to a minimum.
36. The Contractor shall keep the shutdown time to a minimum.
37. The Contractor shall keep the shutdown time to a minimum.
38. The Contractor shall keep the shutdown time to a minimum.
39. The Contractor shall keep the shutdown time to a minimum.
40. The Contractor shall keep the shutdown time to a minimum.
41. The Contractor shall keep the shutdown time to a minimum.
42. The Contractor shall keep the shutdown time to a minimum.
43. The Contractor shall keep the shutdown time to a minimum.
44. The Contractor shall keep the shutdown time to a minimum.
45. The Contractor shall keep the shutdown time to a minimum.
46. The Contractor shall keep the shutdown time to a minimum.
47. The Contractor shall keep the shutdown time to a minimum.
48. The Contractor shall keep the shutdown time to a minimum.
49. The Contractor shall keep the shutdown time to a minimum.
50. The Contractor shall keep the shutdown time to a minimum.
51. The Contractor shall keep the shutdown time to a minimum.
52. The Contractor shall keep the shutdown time to a minimum.
53. The Contractor shall keep the shutdown time to a minimum.
54. The Contractor shall keep the shutdown time to a minimum.
55. The Contractor shall keep the shutdown time to a minimum.
56. The Contractor shall keep the shutdown time to a minimum.
57. The Contractor shall keep the shutdown time to a minimum.
58. The Contractor shall keep the shutdown time to a minimum.
59. The Contractor shall keep the shutdown time to a minimum.
60. The Contractor shall keep the shutdown time to a minimum.
61. The Contractor shall keep the shutdown time to a minimum.
62. The Contractor shall keep the shutdown time to a minimum.
63. The Contractor shall keep the shutdown time to a minimum.
64. The Contractor shall keep the shutdown time to a minimum.
65. The Contractor shall keep the shutdown time to a minimum.
66. The Contractor shall keep the shutdown time to a minimum.
67. The Contractor shall keep the shutdown time to a minimum.
68. The Contractor shall keep the shutdown time to a minimum.
69. The Contractor shall keep the shutdown time to a minimum.
70. The Contractor shall keep the shutdown time to a minimum.
71. The Contractor shall keep the shutdown time to a minimum.
72. The Contractor shall keep the shutdown time to a minimum.
73. The Contractor shall keep the shutdown time to a minimum.
74. The Contractor shall keep the shutdown time to a minimum.
75. The Contractor shall keep the shutdown time to a minimum.
76. The Contractor shall keep the shutdown time to a minimum.
77. The Contractor shall keep the shutdown time to a minimum.
78. The Contractor shall keep the shutdown time to a minimum.
79. The Contractor shall keep the shutdown time to a minimum.
80. The Contractor shall keep the shutdown time to a minimum.
81. The Contractor shall keep the shutdown time to a minimum.
82. The Contractor shall keep the shutdown time to a minimum.
83. The Contractor shall keep the shutdown time to a minimum.
84. The Contractor shall keep the shutdown time to a minimum.
85. The Contractor shall keep the shutdown time to a minimum.
86. The Contractor shall keep the shutdown time to a minimum.
87. The Contractor shall keep the shutdown time to a minimum.
88. The Contractor shall keep the shutdown time to a minimum.
89. The Contractor shall keep the shutdown time to a minimum.
90. The Contractor shall keep the shutdown time to a minimum.
91. The Contractor shall keep the shutdown time to a minimum.
92. The Contractor shall keep the shutdown time to a minimum.
93. The Contractor shall keep the shutdown time to a minimum.
94. The Contractor shall keep the shutdown time to a minimum.
95. The Contractor shall keep the shutdown time to a minimum.
96. The Contractor shall keep the shutdown time to a minimum.
97. The Contractor shall keep the shutdown time to a minimum.
98. The Contractor shall keep the shutdown time to a minimum.
99. The Contractor shall keep the shutdown time to a minimum.
100. The Contractor shall keep the shutdown time to a minimum.

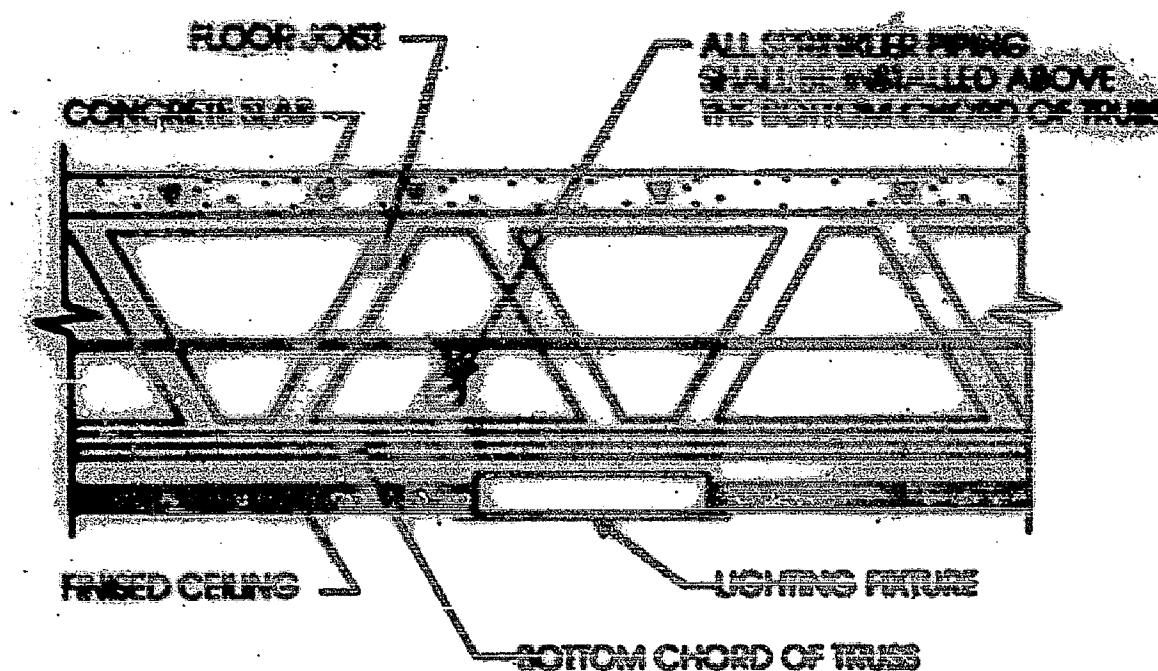


DETAIL OF LOCATION OF PIPE
BY US - 200 CEILING
NOT TO SCALE

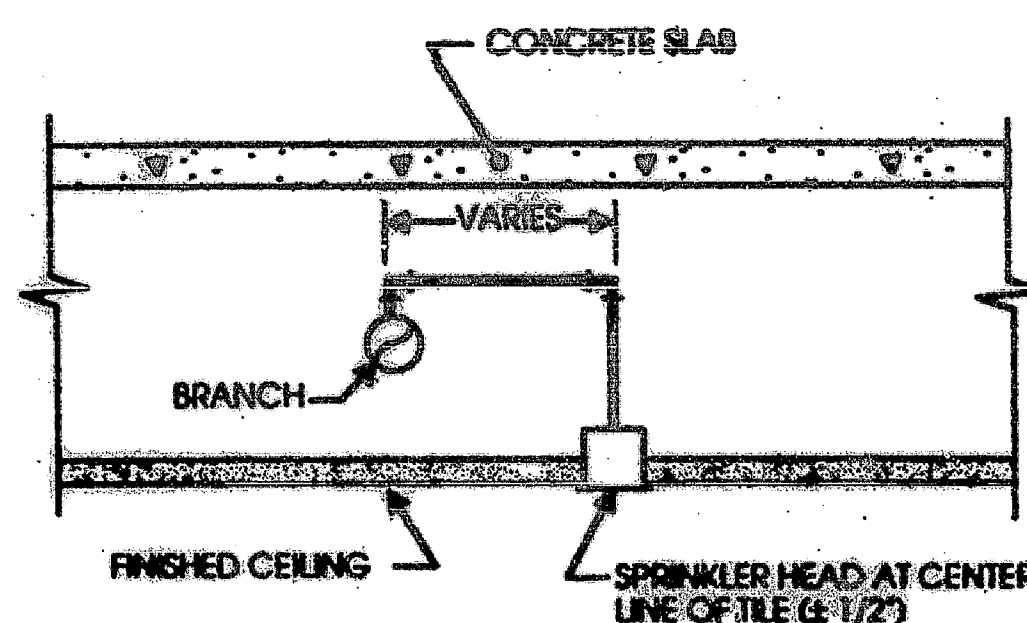

DETAIL OF TYPICAL PIPING
CONNECTION TO SPRINKLER HEAD
NOT TO SCALE

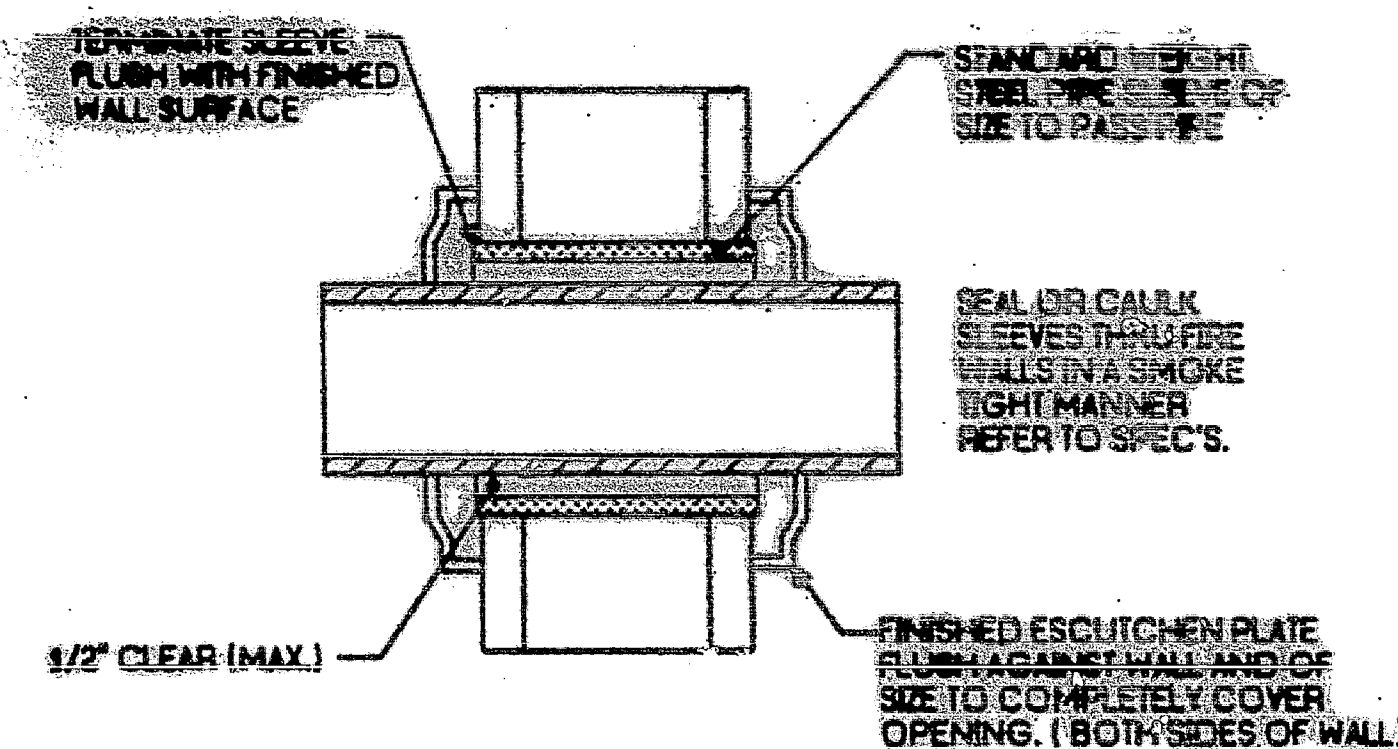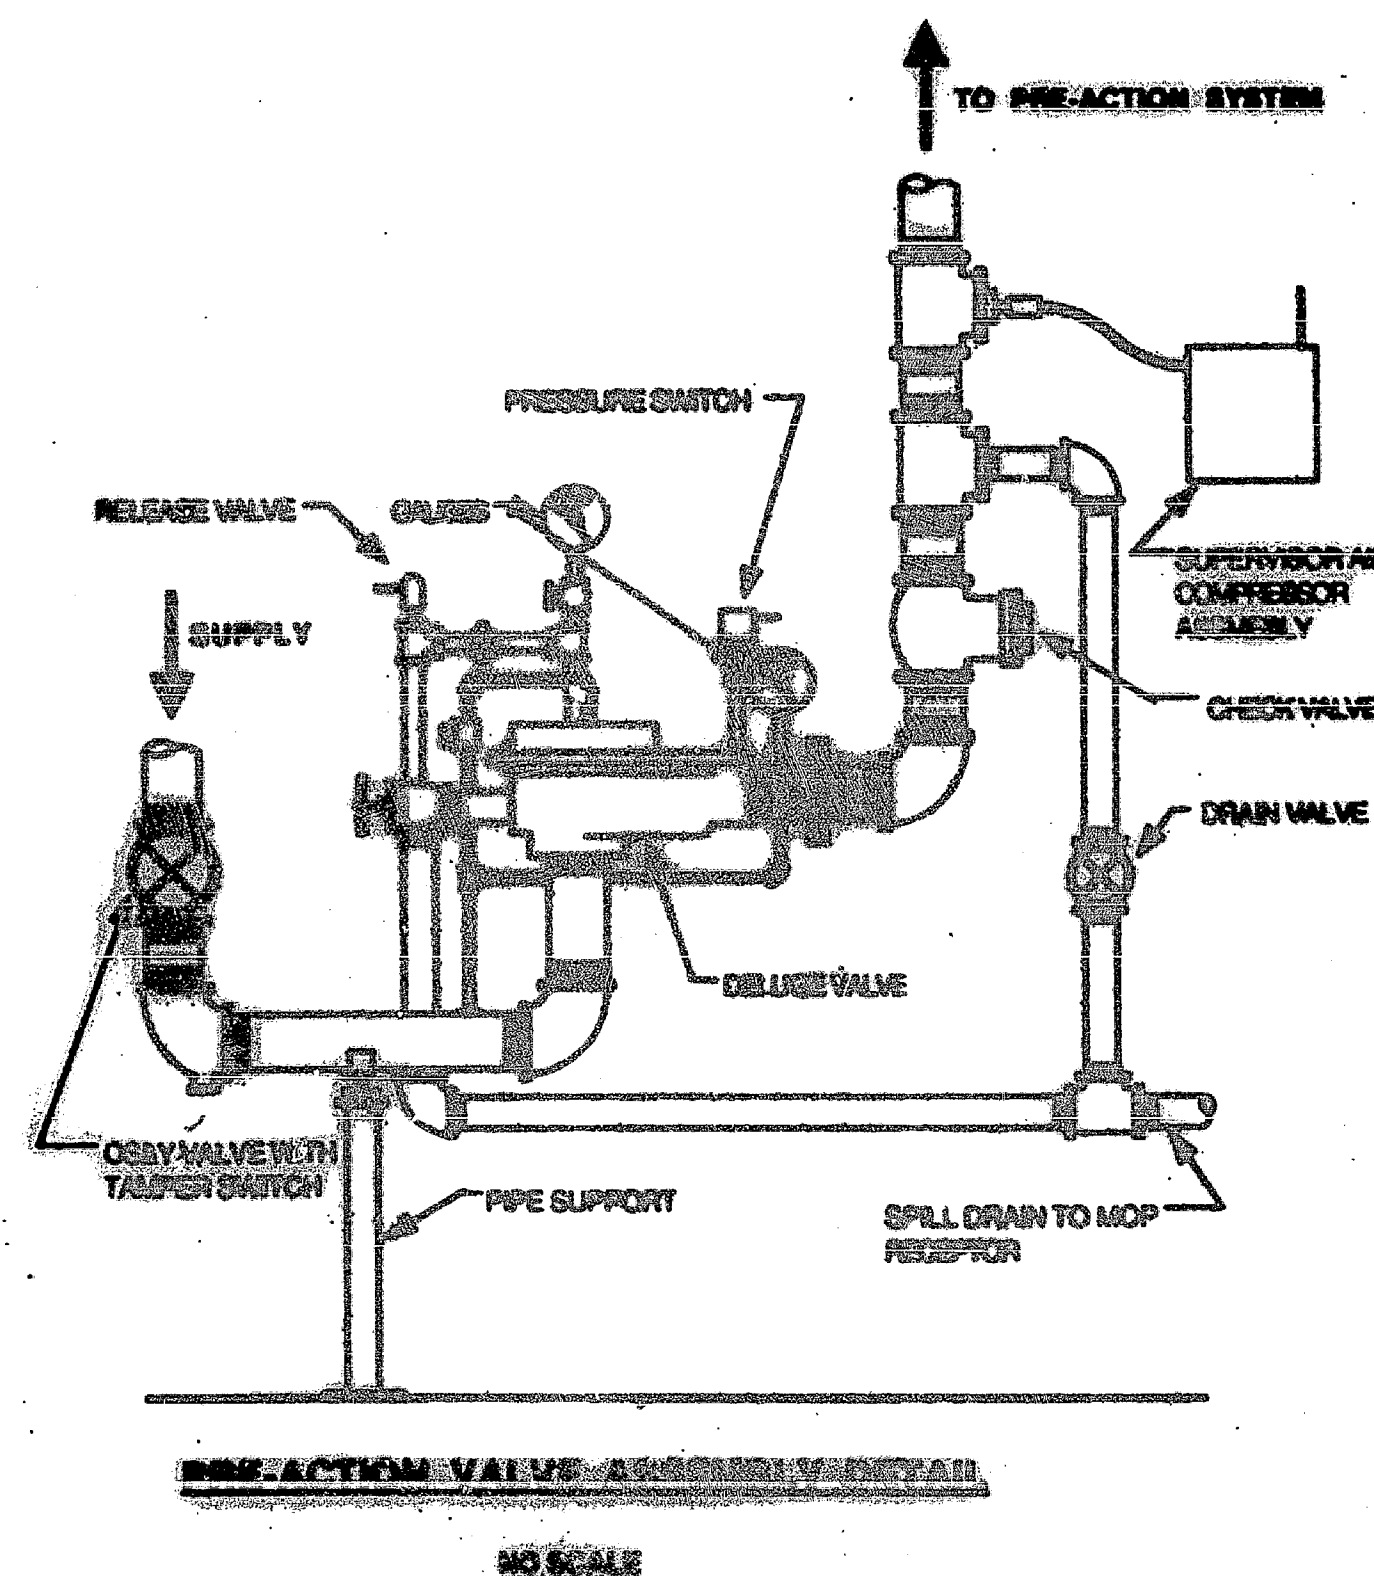

TYPICAL PIPE SLEEVE DETAIL
NOT TO SCALE

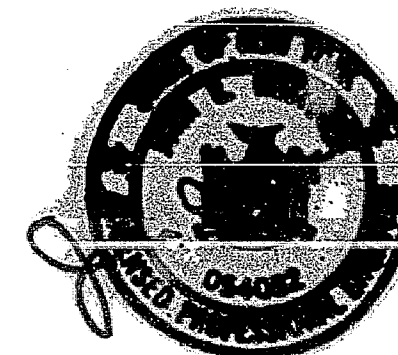

REV. No.	DESCRIPTION	DATE
1	SPRINKLER SPECIFICATIONS & DETAILS	7-3-92
Cantor Fitzgerald Securities One World Trade Center Floor 104 New York, NY 10048		
John C. Westrick & Associates CONSULTING ENGINEERS 2110 Avenue of the Americas South Plainfield, NJ 07080 (908) 641-4570 Fax (908) 750-0264		
SCALE: NONE	DATE: 7-3-92	SP-1